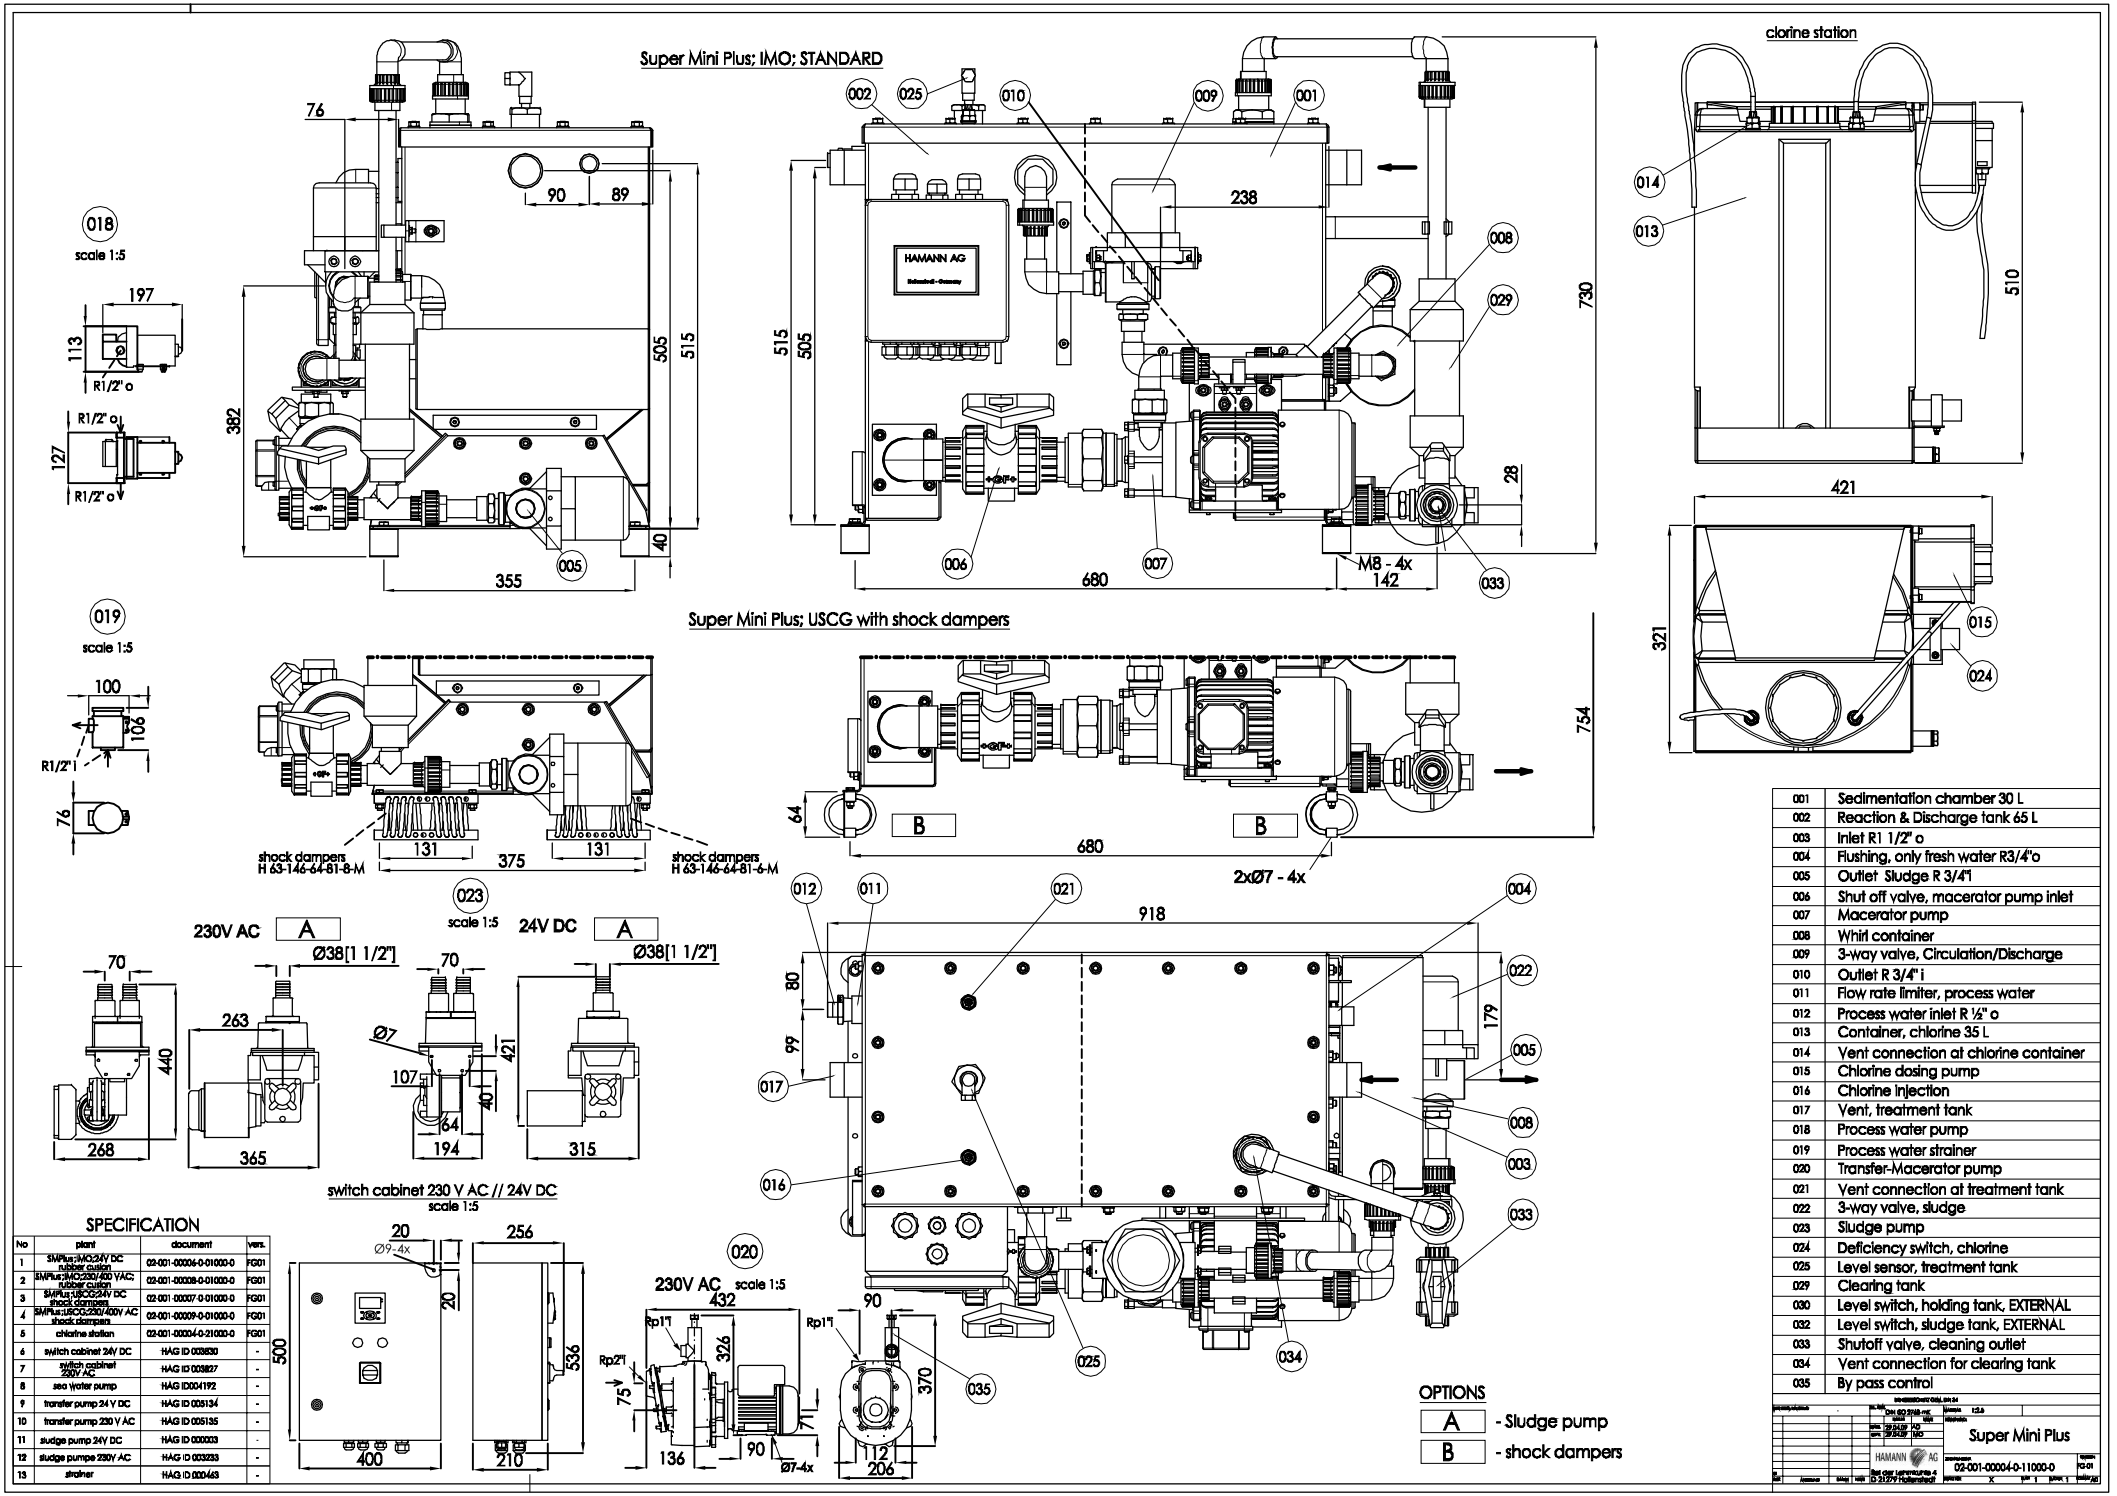

SPECIFICATION

No	plant	document	vers.
1	SMPlus;IMO;24V DC rubber cushion	02-001-00006-0-01000-0	FG01
2	SMPlus;IMO;230/400 VAC; rubber cushion	02-001-00008-0-01000-0	FG01
3	SMPlus;USCG;24V DC shock dampers	02-001-00007-0-01000-0	FG01
4	SMPlus;USCG;230/400V AC shock dampers	02-001-00009-0-01000-0	FG01
5	chlorine station	02-001-00004-0-21000-0	FG01
6	switch cabinet 24V DC	HAG ID 003830	-
7	switch cabinet 230V AC	HAG ID 003827	-
8	sea water pump	HAG ID004192	-
9	transfer pump 24 V DC	HAG ID 005134	-
10	transfer pump 230 V AC	HAG ID 005135	-
11	sludge pump 24V DC	HAG ID 000003	-
12	sludge pumps 230V AC	HAG ID 003233	-
13	strainer	HAG ID 000463	-

001	Sedimentation chamber 30 L
002	Reaction & Discharge tank 65 L
003	Inlet R1 1/2" o
004	Flushing, only fresh water R3/4"o
005	Outlet Sludge R 3/4"i
006	Shut off valve, macerator pump inlet
007	Macerator pump
008	Whirl container
009	3-way valve, Circulation/Discharge
010	Outlet R 3/4" i
011	Flow rate limiter, process water
012	Process water inlet R ½" o
013	Container, chlorine 35 L
014	Vent connection at chlorine container
015	Chlorine dosing pump
016	Chlorine injection
017	Vent, treatment tank
018	Process water pump
019	Process water strainer
020	Transfer-Macerator pump
021	Vent connection at treatment tank
022	3-way valve, sludge
023	Sludge pump
024	Deficiency switch, chlorine
025	Level sensor, treatment tank
029	Clearing tank
030	Level switch, holding tank, EXTERNAL
032	Level switch, sludge tank, EXTERNAL
033	Shutoff valve, cleaning outlet
034	Vent connection for clearing tank
035	By pass control